


PLANNING APPLICATION B/17/0368

Local Authority Consultation

Consultation on a planning application received from a neighbouring local authority for the Installation of high voltage Direct Current cables for the Viking Link interconnector project between proposed landfall at Boygrift in East Lindsey to a proposed converter station at North Ing Drove; installation of Alternative Current cables from the converter station to the existing Bicker Fen 400 kV Substation; as well as permanent access road to converter station, temporary facilities required during construction such as compounds and works areas (Details also submitted to Boston Borough Council under reference B/17/0340)

Viking Link National Grid Sandilands (to Bicker Fen) Mablethorpe

Applicant:
East Lindsey District Council

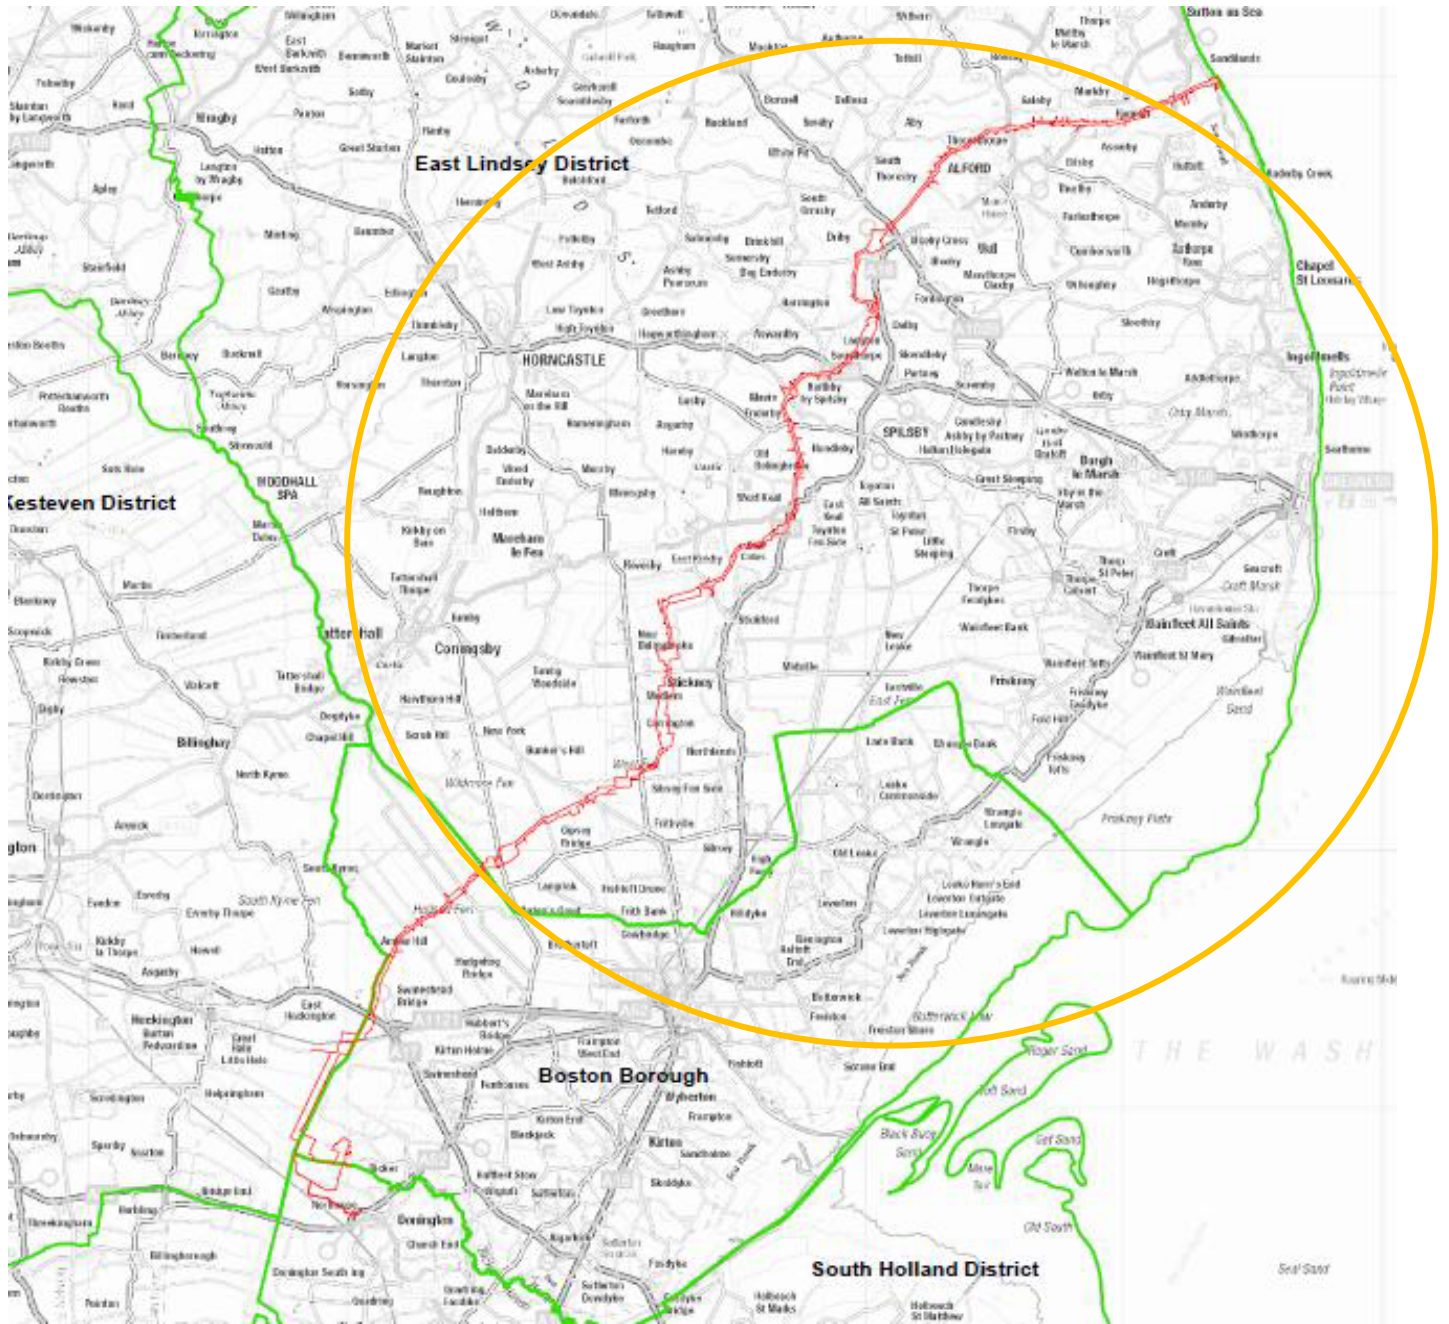

East Lindsey District

HORNCASTLE

West Lindsey District

Spilsby

Alford

Boston Borough

South Holland District

THE WASH

Sea Coast